



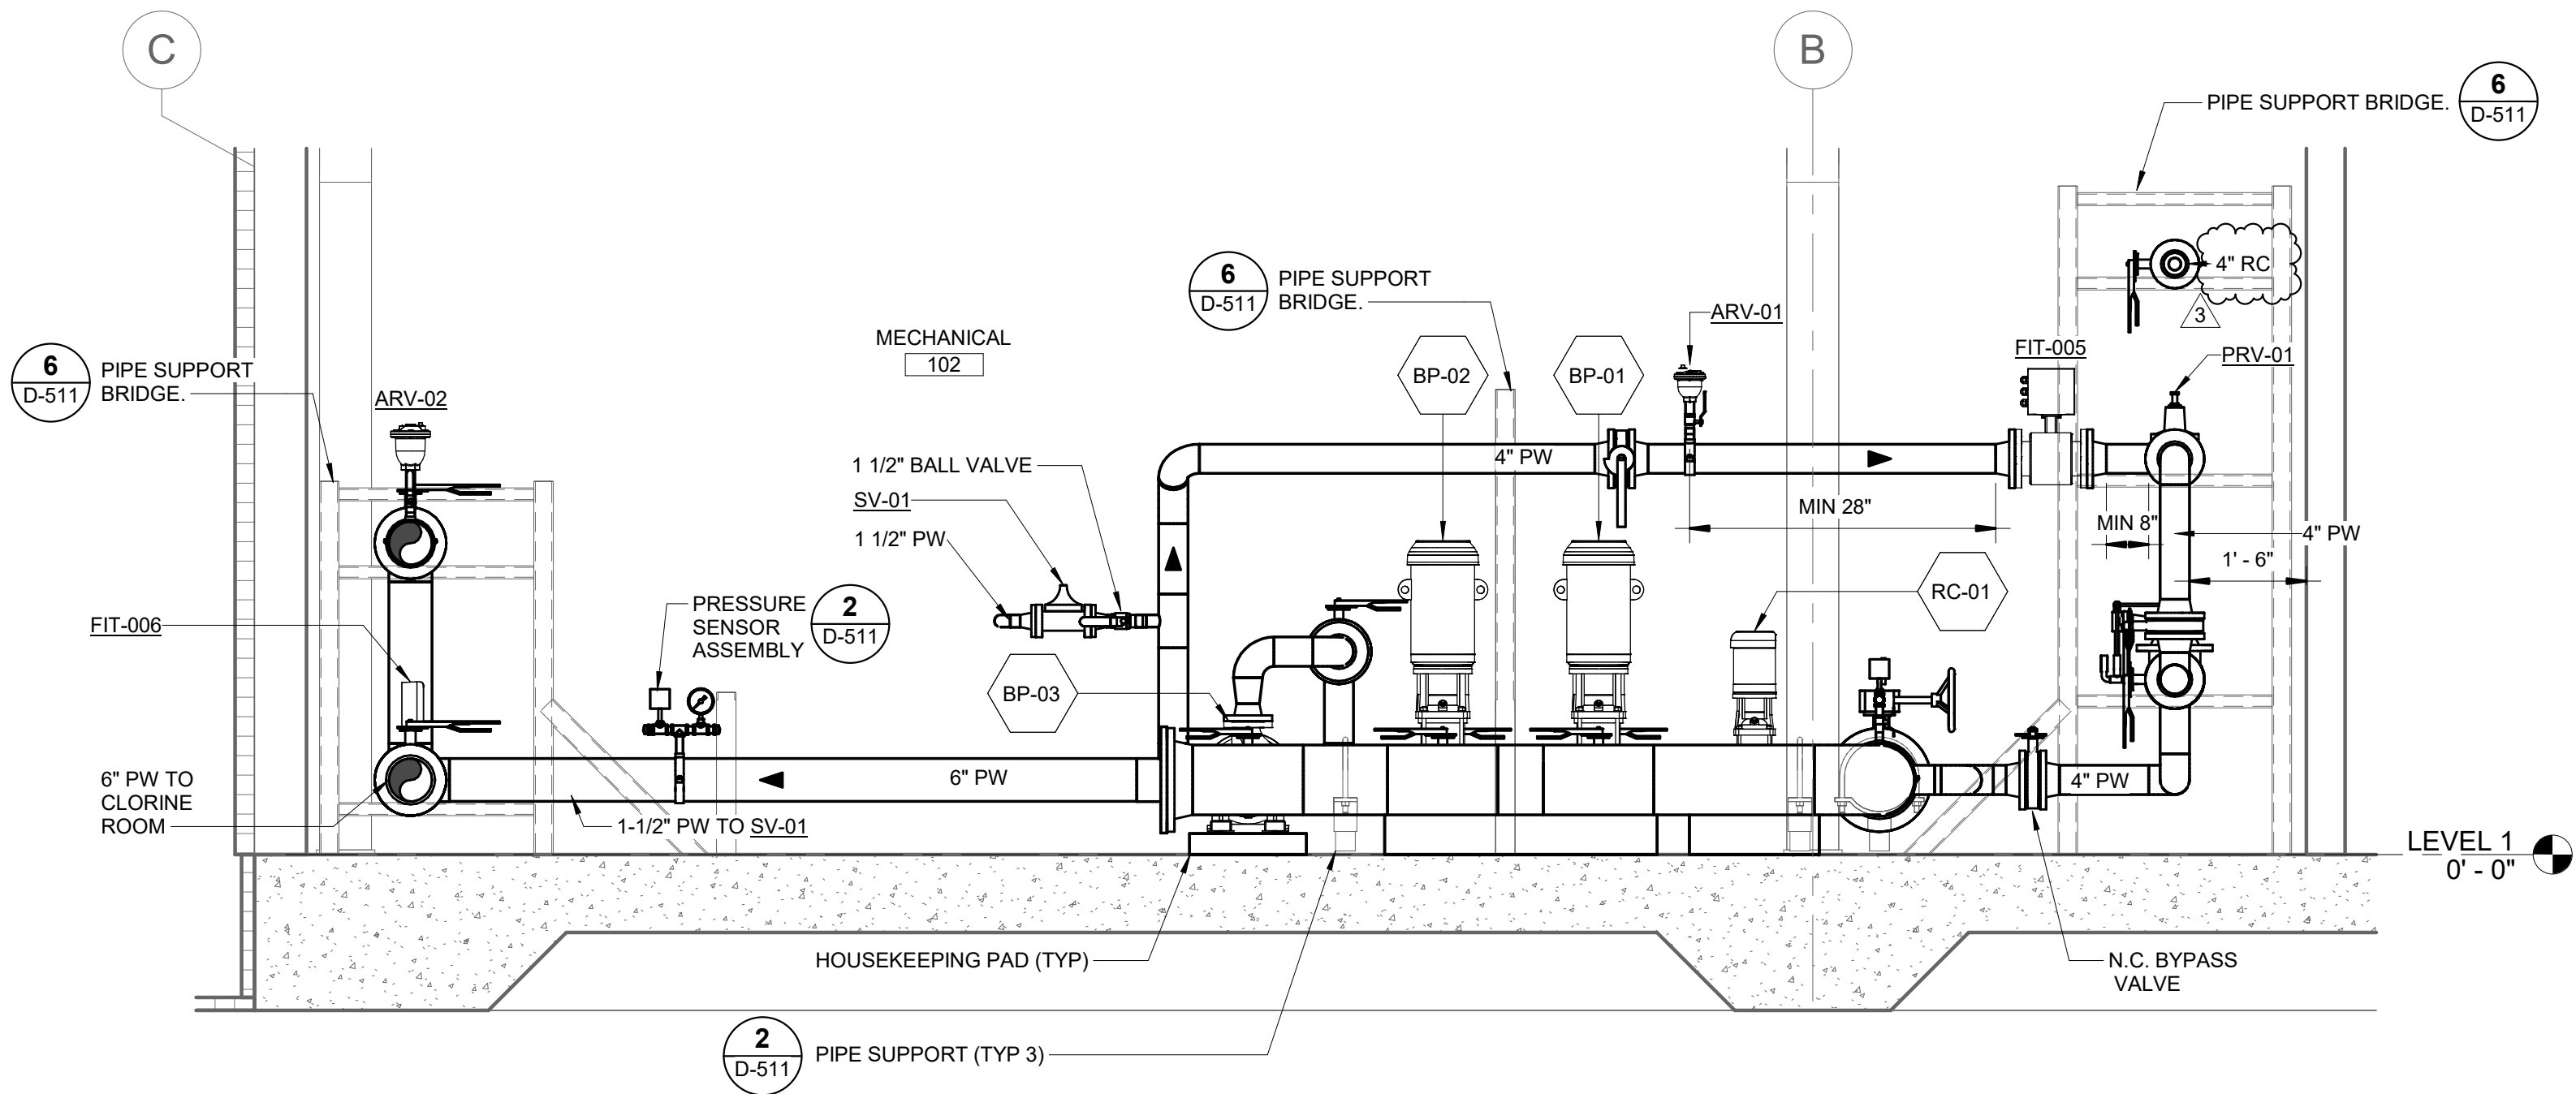

1 PROCESS SECTION - SOUTH
D-302 SCALE: 1/2" = 1'-0"

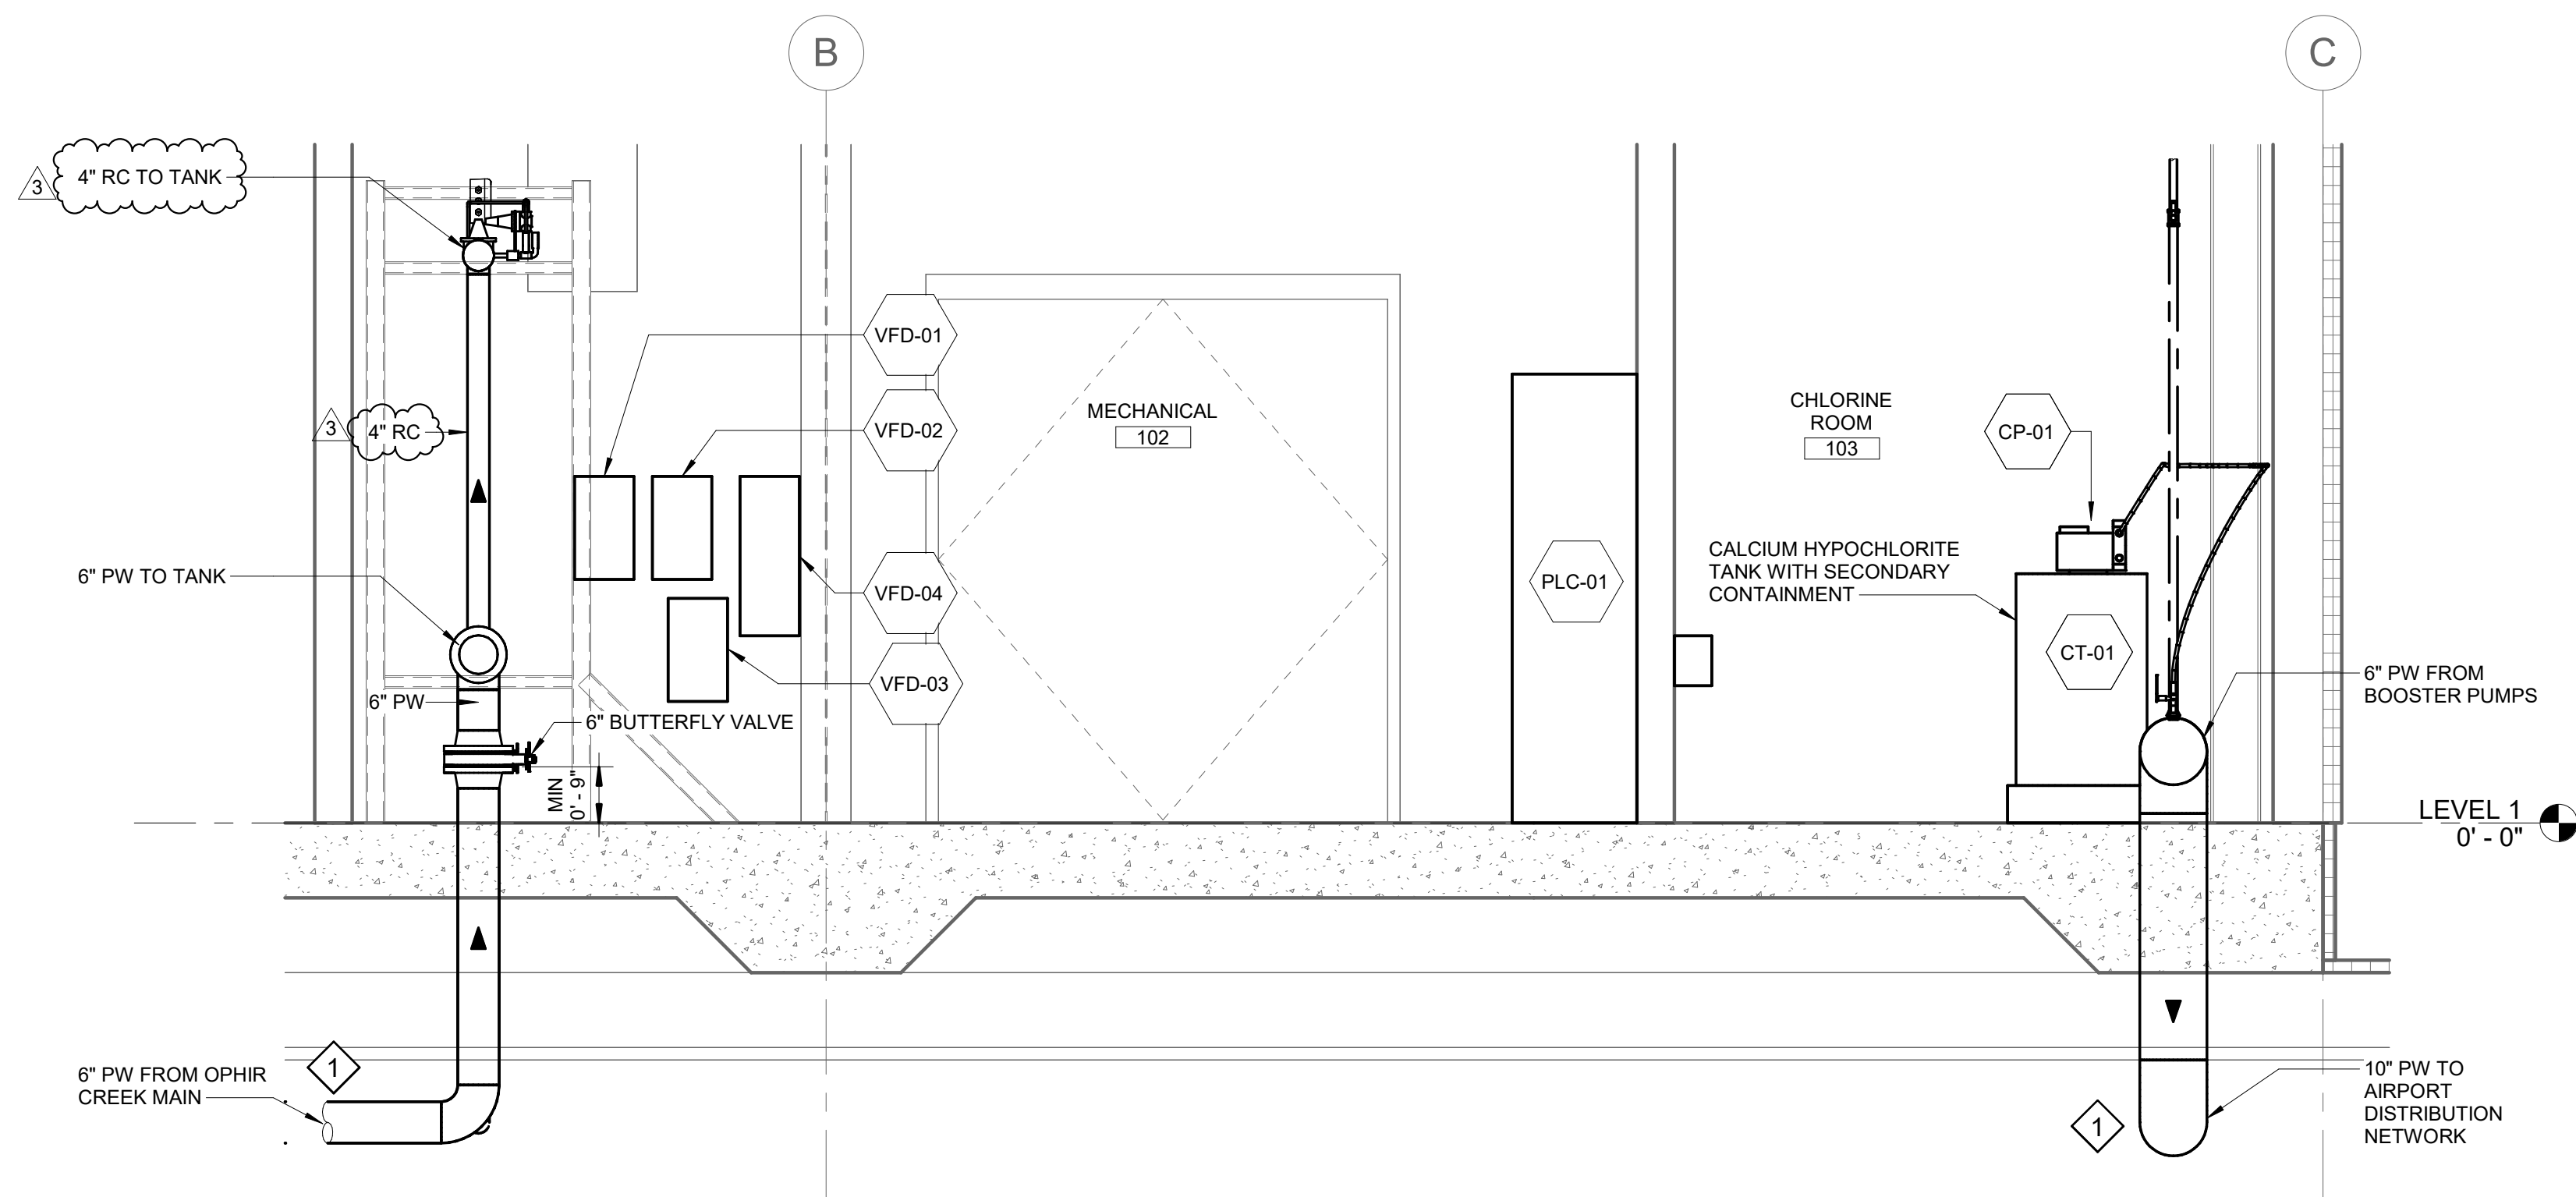

2 PROCESS SECTION - NORTH
D-302 SCALE: 1/2" = 1'-0"


SHEET NOTES

- CONTRACTOR TO SANITIZE ALL PIPE, VALVES, AND FITTINGS PRIOR TO INSTALLATION PER AWWA C-651.
- ALL WETTED COMPONENTS SHALL BE NSF-61 CERTIFIED.
- SPACE PIPE A MINIMUM OF 12-IN FROM BUILDING WALL UNLESS OTHERWISE NOTED.

SHEET KEYNOTES

- ROUTE PIPES BELOW GRADE AND UP THROUGH SLAB. TRANSITION FROM HDPE TO DUCTILE IRON OUTSIDE OF BUILDING FOOTPRINT. SEE CIVIL FOR LOCATION.

CONSULTANT :

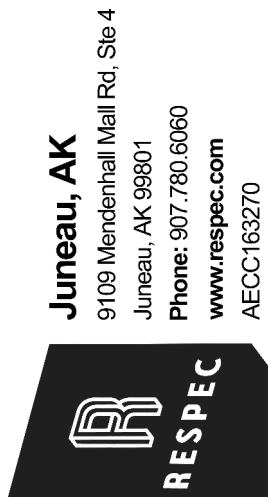

PROJECT :
**CITY & BOROUGH OF YAKUTAT
WATER SYSTEM EXTENSION**

YAKUTAT, ALASKA

SHEET TITLE :
PROCESS SECTIONS

DESIGN	ALN
DRAWN	TRS
CHECKED	LAR
DATE	04-16-2025

PROJECT No.
10297.24002
SHEET NUMBER

D-302

No.	Date	Item
3	9/24/25	ADDENDUM #3
REVISIONS		