



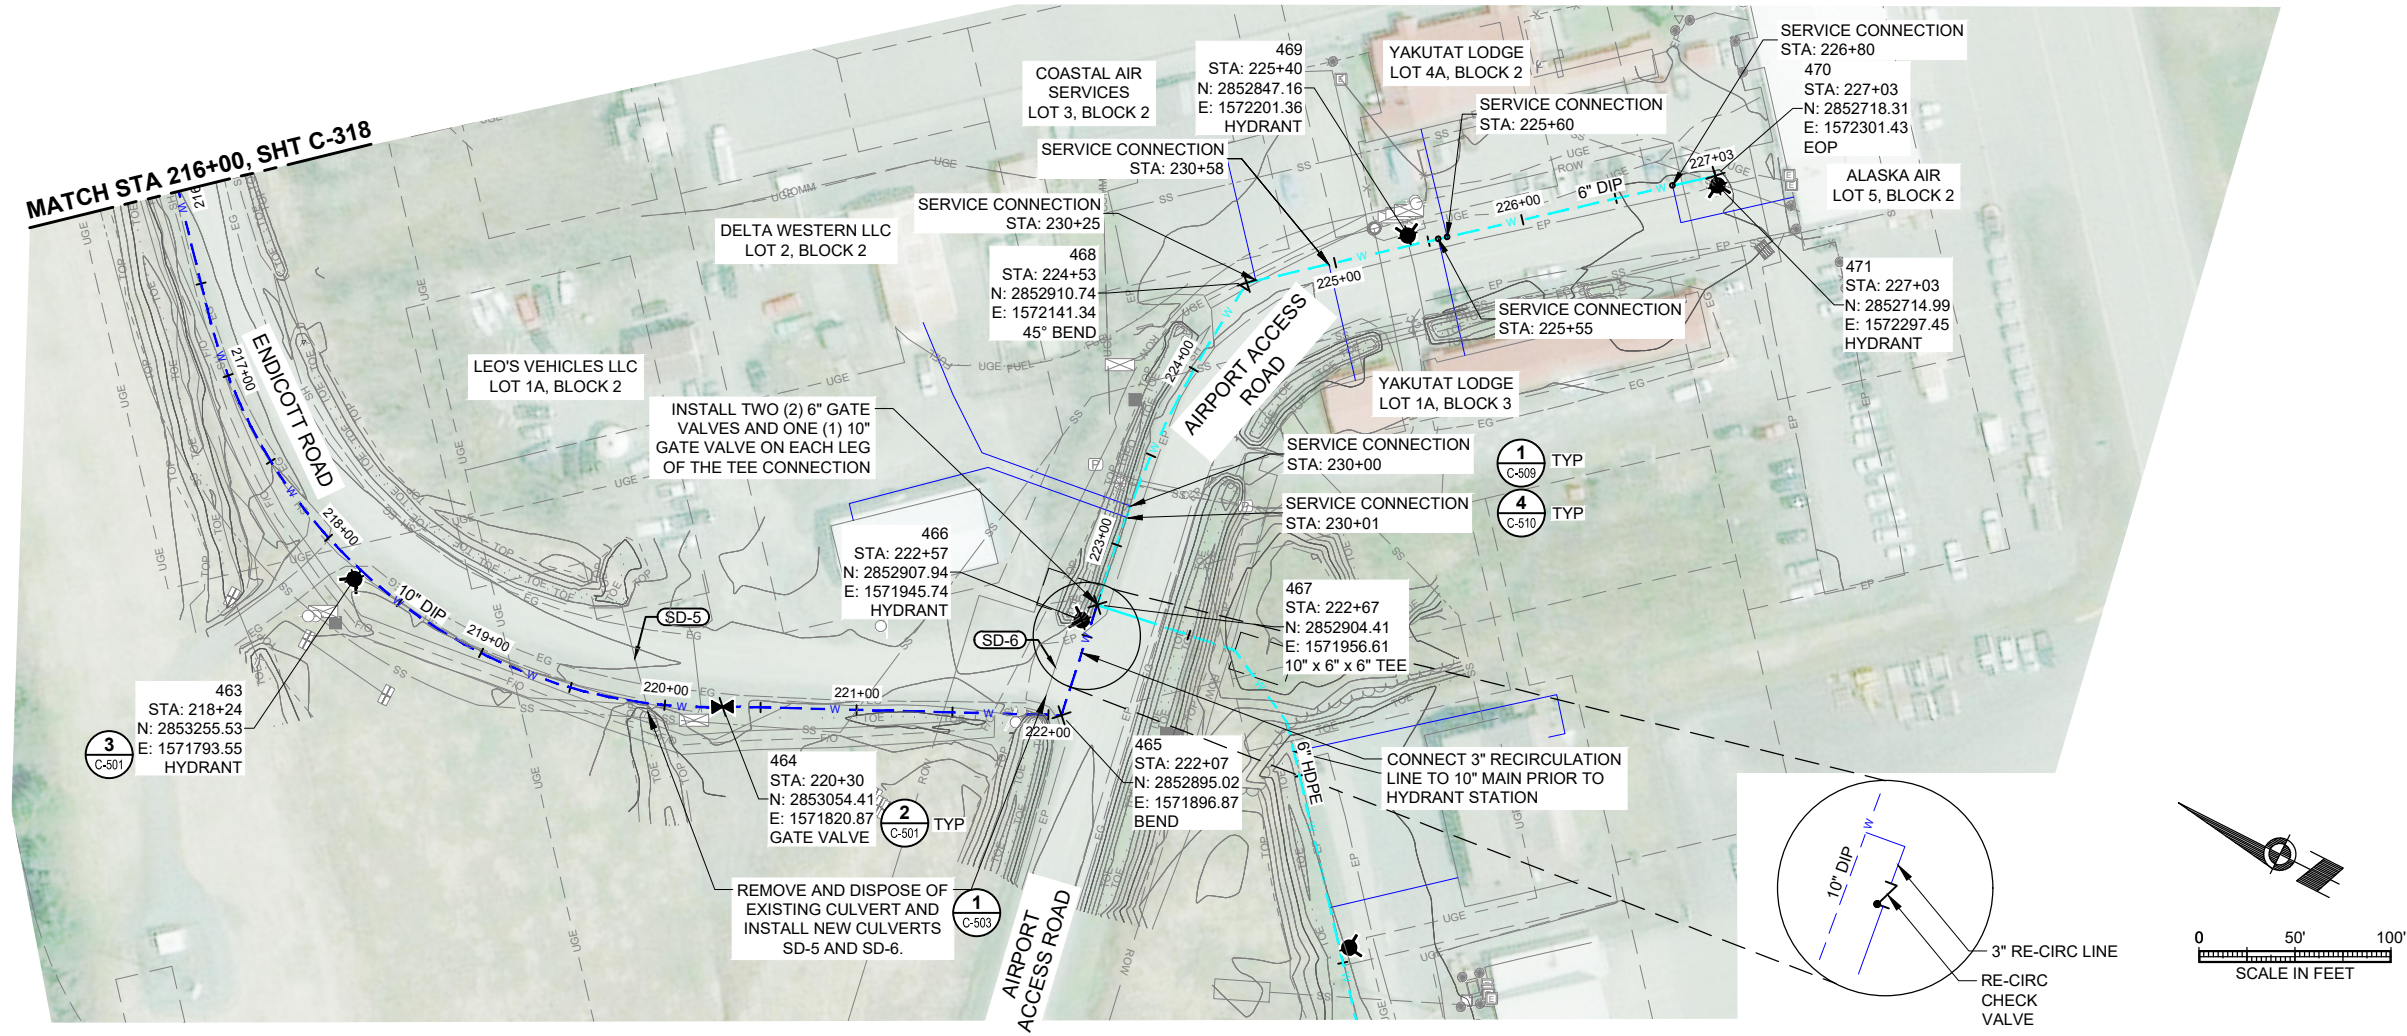

NOTES:

1. IN THE EVENT THAT THE SEWER LINE IS FOUND IN CONFLICT WITH PROPOSED WATER MAIN ELEVATION, INSTALL WATER BELOW SEWER AS SHOWN IN DETAIL 3/C-503.
2. SOILS EXCAVATED FROM STA: 222+75 TO STA: 23+25 SHALL BE SEGREGATED AND DISPOSED OF IN ACCORDANCE WITH THE CONTAMINATED MATERIALS MANAGEMENT PLAN, UNLESS MATERIAL IS SAMPLED AND DETERMINED TO BE BELOW THE APPLICABLE CLEANUP LIMITS.

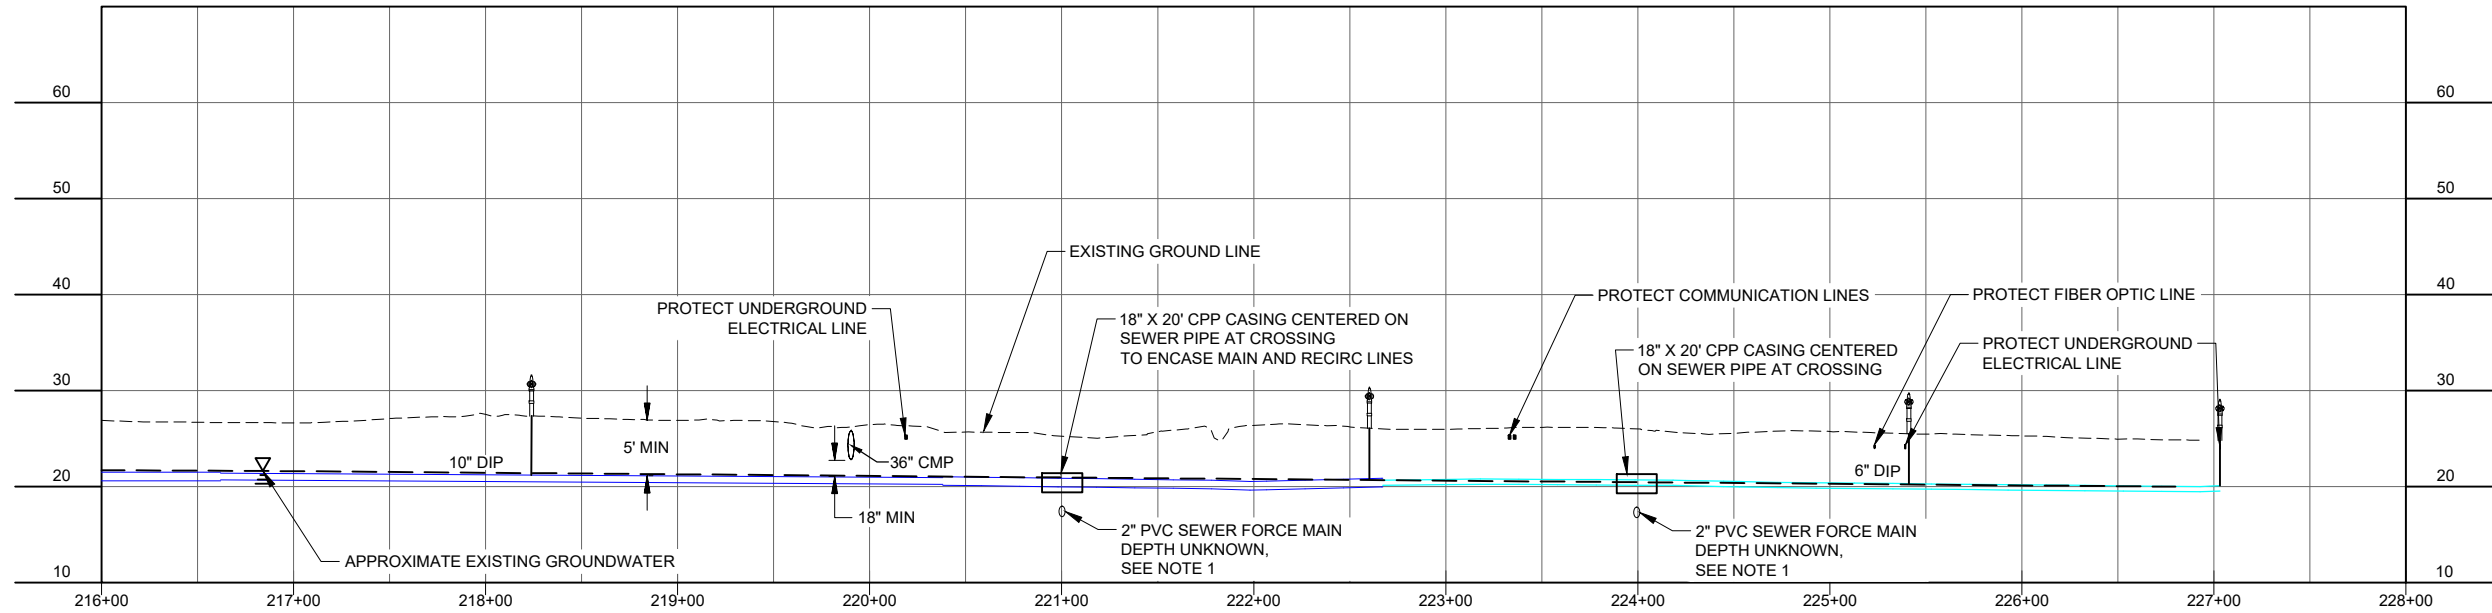

CONSULTANT :



Juneau, AK
9109 Mendota Hall Rd. Ste. 4
Juneau, AK 99801
Phone: 907.586.3771
Fax: 907.586.3771
AEC0163270

PROJECT :
CITY & BOROUGH OF YAKUTAT
WATER SYSTEM EXTENSION

YAKUTAT, ALASKA

SHEET TITLE :
PLAN AND PROFILE -
ENDCOTT ROAD TO
AIRPORT ACCESS ROAD

DESIGN	AMN
DRAWN	HRB
CHECKED	KAB
DATE	08-12-2025

PROJECT No.
10297.24002

SHEET NUMBER
C-319