



9/24/2025 11:28:23 AM Autodesk Docs\\10297.24002\\CBY Airport Water System Extension\\NF-MECH-10297.24002_RV23.rvt IF THIS BAR DOES NOT MEASURE EXACTLY ONE INCH, THE SCALE OF THIS DRAWING HAS BEEN ALTERED DURING ITS PRODUCTION, AFFECTING ALL LABELED SCALES 1"

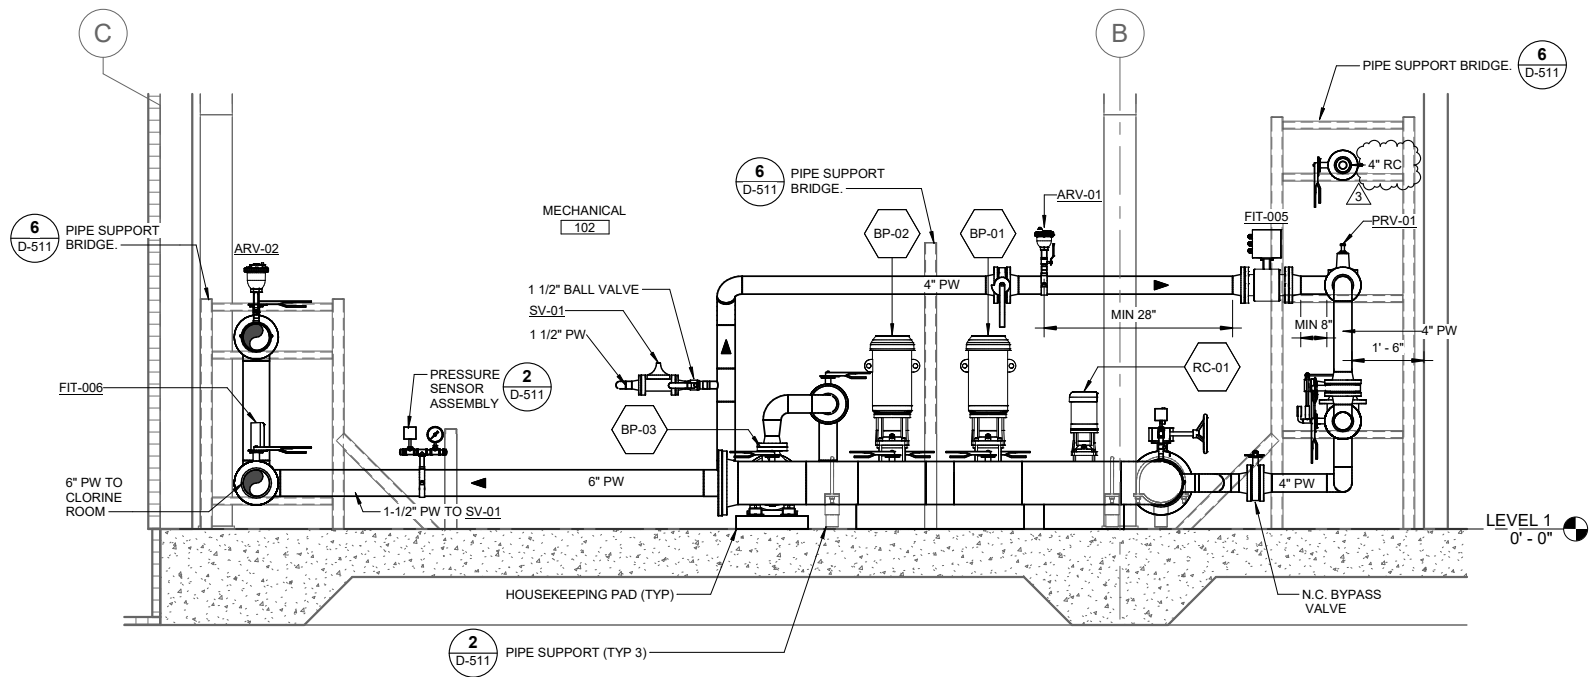

1 PROCESS SECTION - SOUTH
D-302 SCALE: 1/2" = 1'-0"

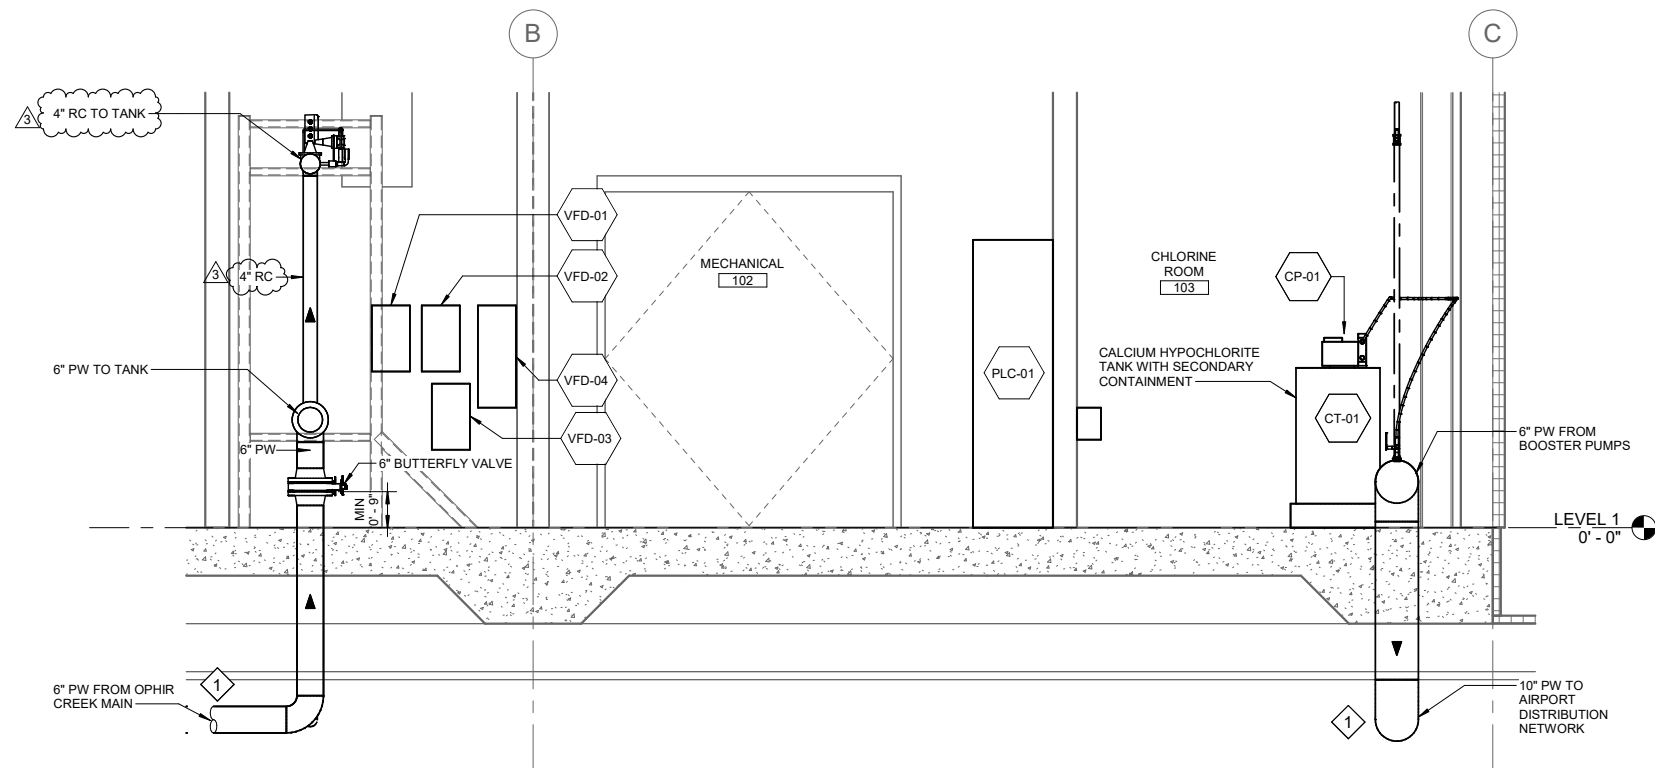

2 PROCESS SECTION - NORTH
D-302 SCALE: 1/2" = 1'-0"


SHEET NOTES

1. CONTRACTOR TO SANITIZE ALL PIPE, VALVES, AND FITTINGS PRIOR TO INSTALLATION PER AWWA C-651.
2. ALL WETTED COMPONENTS SHALL BE NSF-61 CERTIFIED.
3. SPACE PIPE A MINIMUM OF 12-IN FROM BUILDING WALL UNLESS OTHERWISE NOTED.

SHEET KEYNOTES

1. ROUTE PIPES BELOW GRADE AND UP THROUGH SLAB. TRANSITION FROM HDPE TO DUCTILE IRON OUTSIDE OF BUILDING FOOTPRINT. SEE CIVIL FOR LOCATION.

CONSULTANT :



PROJECT :
**CITY & BOROUGH OF YAKUTAT
WATER SYSTEM EXTENSION**
YAKUTAT, ALASKA

SHEET TITLE :
PROCESS SECTIONS

DESIGN ALN
DRAWN TRS
CHECKED LAR
DATE 04-16-2025

PROJECT No.
10297.24002
SHEET NUMBER

D-302

3	9/24/25	ADDENDUM #3	
No.	Date	Item	
REVISIONS			