



1" IF THIS BAR DOES NOT MEASURE EXACTLY ONE INCH, THE SCALE OF THIS DRAWING HAS BEEN ALTERED DURING ITS PRODUCTION, AFFECTING ALL LABELED SCALES


4/17/2025 10:58:12 AM Autodesk Docs://10297.24002-CBY Airport Water System Extension/INF-ELEC-10297.24002_RV23.v1

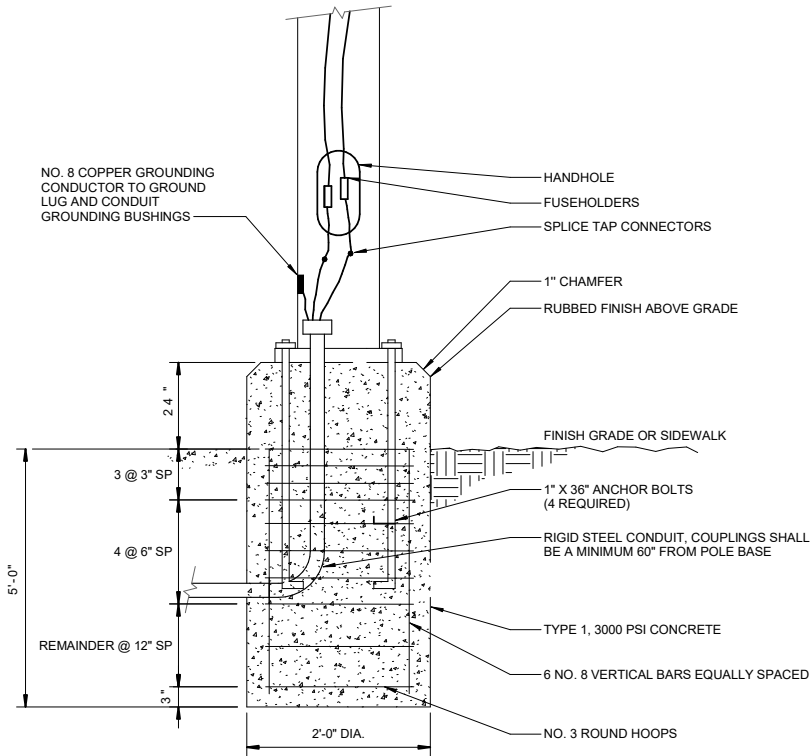


1 LIGHT POLE FOUNDATION DETAIL
E-502 SCALE: NTS

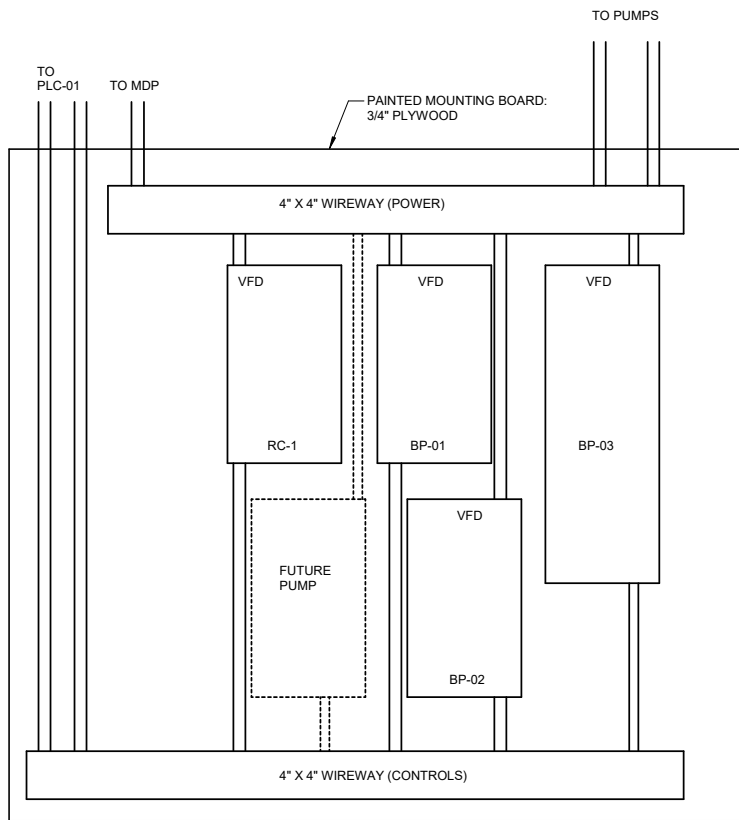

3 ELEVATION - MOTOR CONTROL BOARD
E-502 SCALE: NTS

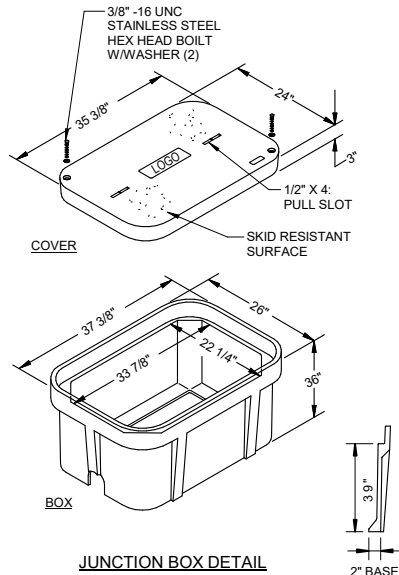

2 HAND HOLE DETAIL
E-502 SCALE: NTS

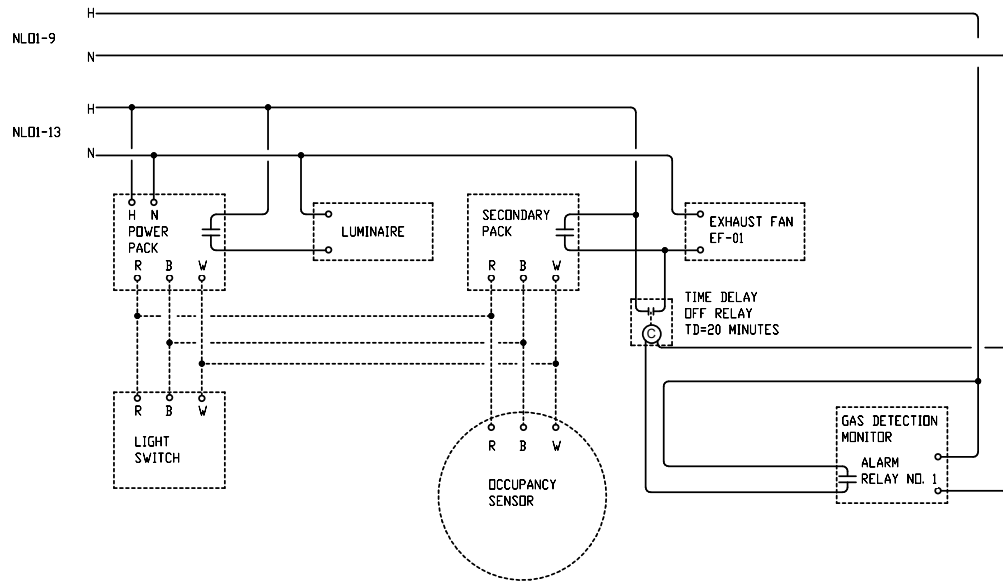


BASIC OF DESIGN

POWER PACK	SENSOR SWITCH PP20 BAA
SECONDARY PACK	SENSOR SWITCH SP20 BAA
LIGHT SWITCH	SENSOR SWITCH sPODM - GY
OCCUPANCY SENSOR	SENSOR SWITCH CM BAA

- NOTE:
- PROGRAM OCCUPANCY AND TIME DELAY RELAY "OFF" DELAY TO 20 MINUTES.
 - MOUNT POWER PACK, SECONDARY PACK, AND TIME-DELAY RELAY IN A NEMA 12 ENCLOSURE ABOVE THE DOOR OUTSIDE THE CHLORINE ROOM.

4 SCHEMATIC DIAGRAM - CHLORINE ROOM LIGHTING/EXHAUST FAN CONTROLS
E-502 SCALE: NO SCALE

CONSULTANT :



PROJECT :
**CITY & BOROUGH OF YAKUTAT
WATER SYSTEM EXTENSION**
YAKUTAT, ALASKA

SHEET TITLE :
DETAILS

DESIGN	SH
DRAWN	CSB
CHECKED	BCH
DATE	04-16-2025

PROJECT No.
10297.24002
SHEET NUMBER

E-502

No.	Date	Item
REVISIONS		